


VALVE MARKER POST


VALVE MARKER POST WILL BE REQUIRED UNLESS VALVE IS IN PAVEMENT AND TOP OF VALVE BOX IS AT FINISHED GRADE.

BLOW-OFF ASSEMBLY MARKER POST

BLOW-OFF MARKER POST WILL BE REQUIRED UNLESS BLOW-OFF IS IN PAVEMENT.

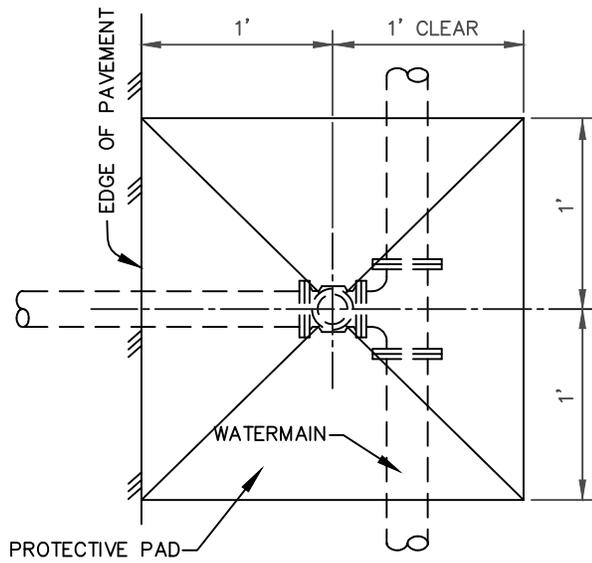

PLAN

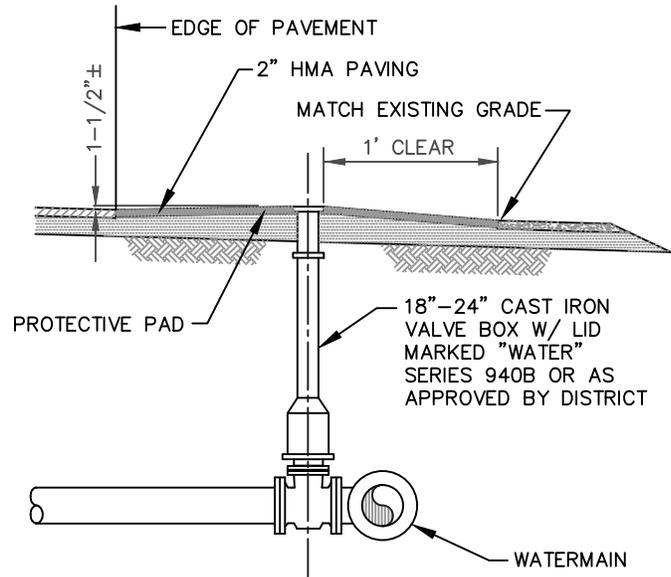

SECTION

VALVE BOX PROTECTIVE PAD

NOTE:
 MARKER POST SHALL BE PAINTED WITH 2 COATS OF WHITE PAINT, LETTERS SHALL BE 2" HIGH AND STENCILED IN BLACK PAINT. MARKER POST SHALL BE LOCATED 10 FT. (MIN.) AWAY FROM EDGE OF ROAD WAY.



VALVE BOX PROTECTIVE PAD AND MARKER POST

REVISION DATE MAY 17, 2011	SCALE NTS	DISTRICT APPROVAL Gregory G. Hill, P.E.	DATE APPROVED APRIL 27, 2023
FILE NAME W-13.DWG		DWG. NO.	W-13