


**PLAN**

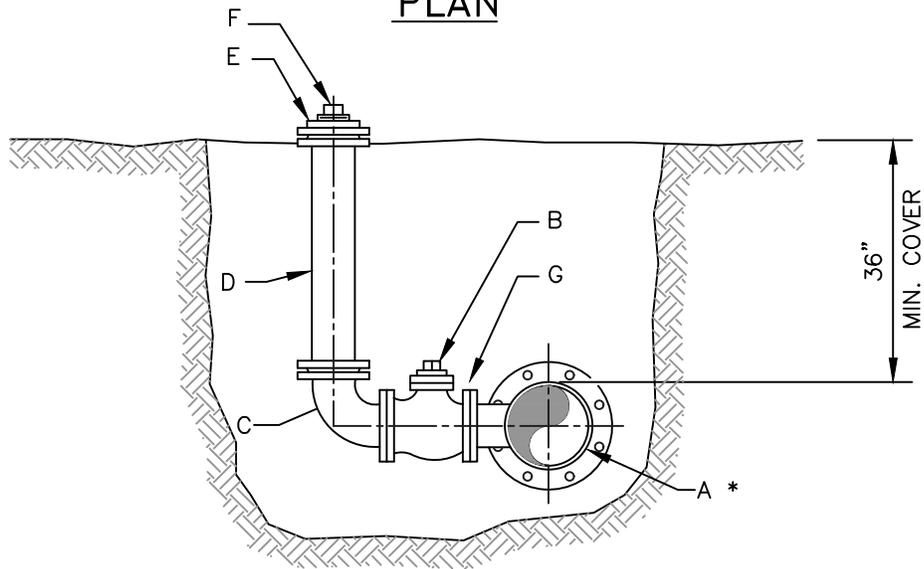

**ELEVATION**

PART NO.	PART DESCRIPTION	BLOW OFF SIZE		
		4"	6"	8"
A	D.I. TEE (FL x MJ) BRANCH SIZE *	4"	6"	8"
B	G.V. (FL x FL)	4"	6"	8"
C	90° BEND (FL x MJ)	4"	6"	8"
D	RISER D.I.P. x LENGTH AS REQ'D	4"	6"	8"
E	MJ CAP W/ MEGALUGS TAPPED FOR 4" IPT (3" IPT FOR 4" BLOW OFF)	4"	6"	8"
F	PLASTIC PLUG	3"	4"	4"
G	BLIND FLANGE (AFTER FLUSHING, REMOVE GATE VALVE & RISER)	4"	6"	8"
H	MJ PLUG	MAIN	SIZE	

\* TEE SIZE SAME AS WATER MAIN UNLESS OTHERWISE INDICATED.  
ALTERNATIVELY D.I. TEE (MJ x MJ) WITH PLUG, SUBJECT TO FUTURE  
EXTENSION & GATE VALVE.



## 4", 6" OR 8" TEMPORARY BLOWOFF ASSEMBLY

REVISION DATE JANUARY 10, 2023	SCALE NTS	DISTRICT APPROVAL <i>Gregory G. Hill, P.E.</i>	DATE APPROVED APRIL 27, 2023
FILE NAME W-17.DWG		DWG. NO.	W-17