


PLAN

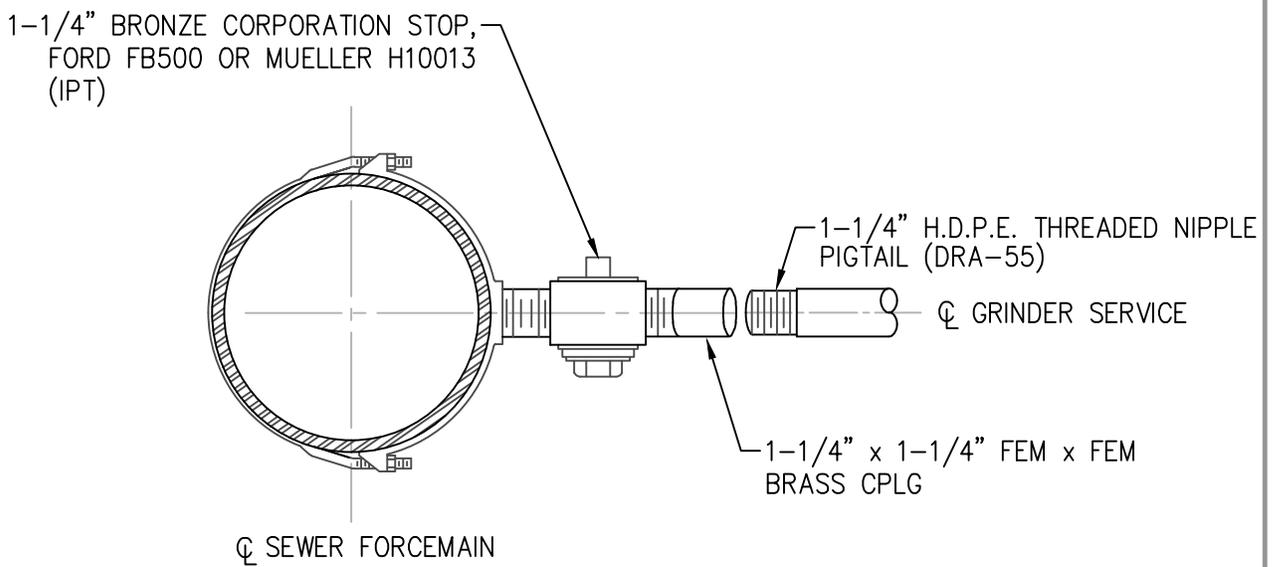

ELEVATION

NOTES:

1. GRINDER LINE FITTINGS: ALL FITTINGS SHALL BE CAST FROM WATER WORKS BRASS CONFORMING TO C800-89.
2. MUNICIPAL SERVICE PIPE: IRON PIPE SIZE SDR 11 WITH STAINLESS STEEL TRACER WIRE, 7x7 AIRCRAFT CABLE, 1/8" DIAMETER AND WARNING TAPE MARKED "SEWER" 12" ABOVE. CONNECT SERVICE PIPE TRACER WIRE TO FORCE MAIN TRACER WITH STAINLESS STEEL CLAMP.
3. FOR HDPE FORCE MAIN, USE SPRING WASHERS ON SADDLE.



**GRINDER SERVICE CONNECTION
TAPPED ON EXISTING FORCE MAIN**

REVISION DATE MARCH 15, 2023	SCALE NTS	DISTRICT APPROVAL <i>Gregory G. Hill, P.E.</i>	DATE APPROVED APRIL 18, 2023
FILE NAME S-22.DWG		DWG. NO.	S-22