



NOTES:

TRACER WIRE STATIONS SHALL BE SPACED AT 300-FT OR LESS


BRING TRACER WIRE WITHIN 1 FOOT OF SURFACE. EXTENSIONS ARE REQUIRED WHEN THE FORCE MAIN IS MORE THAN FOUR (4) FEET BELOW FINISHED GRADE. EXTENSIONS ARE TO BE A MINIMUM OF TWO (2) FEET LONG. ONE EXTENSION IS TO BE USED PER TRACER WIRE RISER.

ALL EXTENSIONS ARE TO BE MADE OF STEEL, SIZED AS NOTED, AND PAINTED WITH TWO (2) COATS OF METAL PAINT.

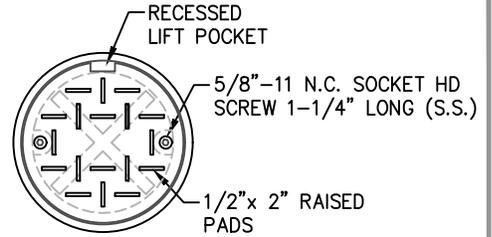


CAST IRON RING & LOCKING COVER, "OLYMPIC FOUNDRY COMPANY" NO. M-1025 w/ H-20 RATING MARKED "SEWER"

CONCRETE PAD, 24"x24"x8" (OR INSTALL IN PAVEMENT) SLOPE AWAY w/ BRUSH FINISH



PLAN

11"x8" LOCKING CLEANOUT

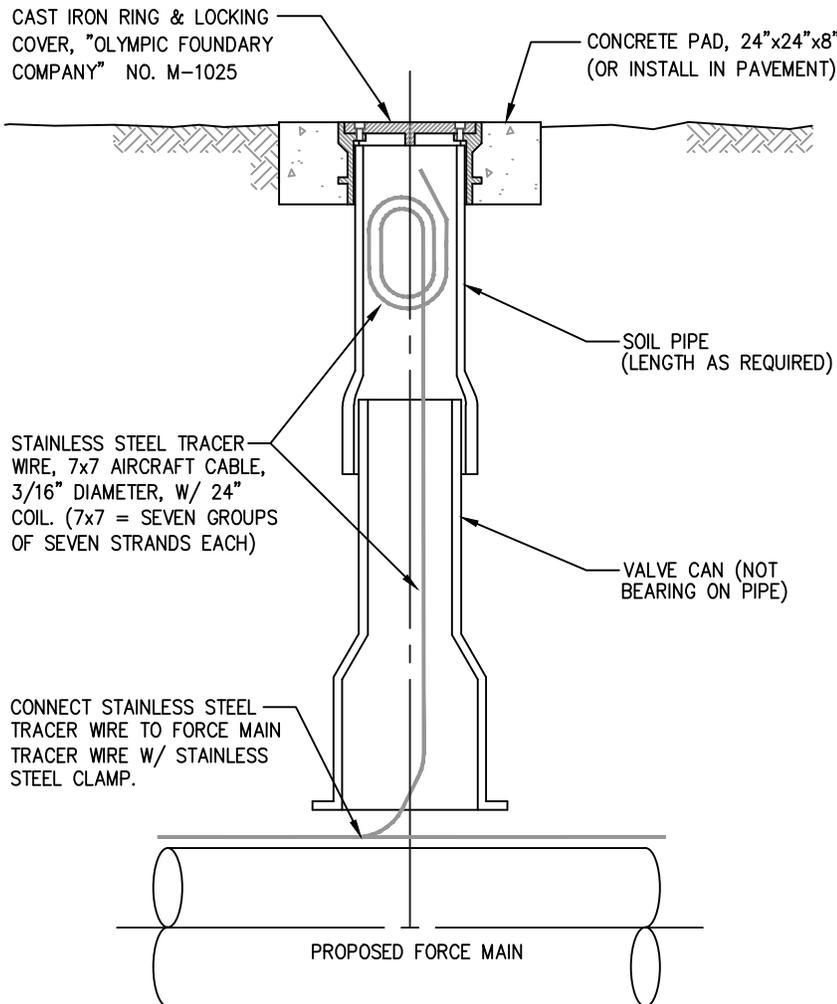

SEWER FORCE MAIN TRACER WIRE RISER

REVISION DATE MARCH 15, 2023	SCALE NTS	DISTRICT APPROVAL <i>Gregory G. Hill, P.E.</i>	DATE APPROVED APRIL 18, 2023
FILE NAME S-31.DWG		DWG. NO.	S-31